

Lions Floor

TEST REPORT

SCOPE OF WORK

SPC FLOORING

REPORT NUMBER

260714002SHF-001

TEST DATE(S)

2026-07-14 - 2026-08-20

ORIGINAL ISSUE DATE

2026-08-20

PAGES


12

DOCUMENT CONTROL NUMBER

LFT-APAC-SHF-OP-10k(January 13, 2025)

© 2025 INTERTEK

Intertek Testing Services Shenzhen Ltd. Shanghai Fengxian Branch

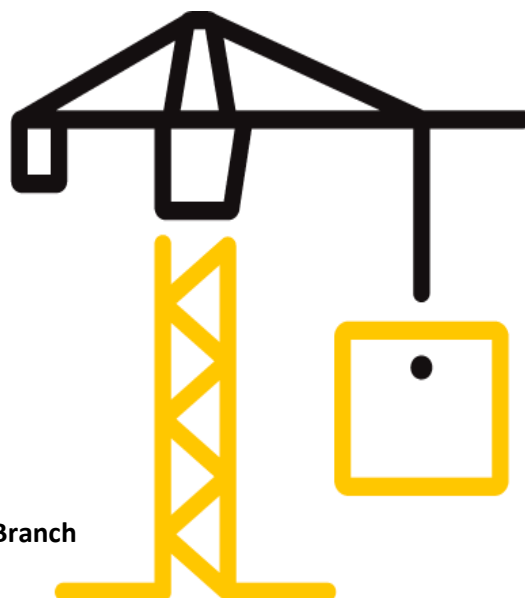

Test Report

Statement

- 1.This report is invalid without company's special seal for testing on the assigned page.
- 2.This report is invalid without an authorized person's signature.
- 3.This report is invalid if altered.
- 4.Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Don't copy this report in partial without any official approval in written by our company. This report is invalid without re-stamping the special seal for testing in copying report.
- 5.This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.
- 6.Except for the obligation, responsibility and liability (if any) for the appropriateness and professionalism of afore-mentioned testing itself within the scope and amount of the testing fee received, Intertek does not and will not accept any other obligation or liability.
- 7.If the Client has any questions about the test results, Intertek B&C should be informed within the storage period of the samples. The sample storage period ends 5 working days after the official report issue date. Samples of certification program are retained for the period required by the certification rules. The samples storage period shall be calculated according to the issue date of the original report in the case of quoting results and modifying reports.
- 8.Intertek B&C will service this report for the entire test record retention period. The test record retention period ends 6 years after this report original issue date. The test record retention period for certification program is 10 years. Test records and other pertinent project documentation will be retained for the entire test record retention period.
- 9.The report was digital signed by Shang Hai, Intertek Group plc, please using Adobe Acrobat Reader to verify the authenticity.

Test Report

Original Issue Date: 2026-08-20

Intertek Report No. 260714002SHF-001

Applicant: Lions Floor

Address: 7300 somerset blvd,paramount, CA 90723

Attn: Jerry Guo

Test Type: Performance test, samples provided by the applicant.

Product Information

Product Name	Model	Specification
SPC FLOORING	Bambino Collection	180*1220*4.7mm(3.7mmSPC+1.0mmIXPE)
Sample ID	Sample Amount	Sample Received Date
S260714002SHF.001~008	50 pcs	2026-06-08
Sample Description		
180*1220*4.7mm (with 1mm underlayment)		

Test Methods And Standards

Test Standard	ASTM F3261-25a section 8.1, 8.3, 8.5, 8.6, 8.7 and 8.9; ASTM F387-17(2022); ASTM F410-08(2022); ASTM F1914-18(2023); ASTM F2199-20; ASTM F1514-19(2025); ASTM F1515-21; ASTM F970-22; ASTM D2047-25
Specification Standard	/
Test Conclusion	The samples were tested according to the above standards, and the results are shown in the following page.

Note:

1.This report does not involve sampling. The report only reflects conformity of the tested items of the samples provided by the applicant. Representativeness and authenticity of the submitted samples are responsibilities of the applicant.

Report Authorized


Name: Flora Fan Name: Wilson Zhang
Title: Reviewer Title: Project Engineer

Test Report

Original Issue Date: 2026-08-20

Intertek Report No. 260714002SHF-001

Test Items, Method and Results:

Test Item: Thickness

Test Method: ASTM F387-17(2022)

Conditioning: Condition the test specimens at $(23 \pm 2)^{\circ}\text{C}$ and $(50 \pm 5)\%$ relative humidity for at least 24h

Test Condition:

Foot diameter of thickness gage: 6.35 mm

Mass applied: 28 g

Product with foam back layer: Yes

Test Result:

Nominal value: 4.7 mm

Average value: 4.71 mm

Tolerance: 0.01 mm

Max. value: 4.72 mm

Min. value: 4.70 mm

Test Report

Original Issue Date: 2026-08-20

Intertek Report No. 260714002SHF-001

Test Items, Method and Results:

Test Item: Wear layer thickness

Test Method: ASTM F410-08(2022)

Conditioning: Condition the test specimens at $(23 \pm 2)^{\circ}\text{C}$ and $(50 \pm 5)\%$ relative humidity for at least 24h

Test Result:

Nominal value:	0.30 mm
Average value:	0.31 mm
Max. value:	0.32 mm
Min. value:	0.30 mm

Test Report

Original Issue Date: 2026-08-20

Intertek Report No. 260714002SHF-001

Test Items, Method and Results:

Test Item: Residual indentation

Test Method: ASTM F3261-25a section 8.1 and ASTM F1914-18(2023)

Conditioning: Condition the test specimens at $(23 \pm 2)^{\circ}\text{C}$ and $(50 \pm 5)\%$ relative humidity for at least 24h

Test Condition:

Indenter:	Steel cylindrical foot
Indenter diameter:	6.35 mm
Total load applied:	34 kg
Indentation time:	15 min
Recovery time:	60 min

Test Result:

Residual Indentation	Result (mm)
Specimen 1	0.06
Specimen 2	0.06
Specimen 3	0.07
Average value	0.06
Max. value	0.07

Test Report

Original Issue Date: 2026-08-20

Intertek Report No. 260714002SHF-001

Test Items, Method and Results:

Test Item: Dimensional stability and curling

Test Method: ASTM F3261-25a section 8.3 and ASTM F2199-20

Conditioning:

Temperature: 23 °C

Relative humidity: 50 %

Duration: 24 h

Measure the initial length and curling

Test Condition:

Temperature: 70 °C

Duration: 6 h

Reconditioning:

Temperature: 23 °C

Relative humidity: 50 %

Duration: 24 h

Measure the final length and curling

Test Result:

Specimen	Dimensional stability (%)		Curling (in)
	Length direction/Machine direction	Width direction/Across machine direction	
1	-0.08	0.06	0.002
2	-0.08	0.04	0.002
3	-0.08	0.04	0.002
Average	-0.08	0.05	0.002
Max.	-0.08	0.06	0.002

Note:

1. Dimensional stability = (final length - initial length)×100/initial length

A negative value indicates shrinkage, and a positive value indicates expansion.

2. Curling = final curling - initial curling = Curl

Express the average value to the nearest 0.001in

Test Report

Original Issue Date: 2026-08-20

Intertek Report No. 260714002SHF-001

Test Items, Method and Results:

Test Item: Resistance to heat

Test Method: ASTM F3261-25a section 8.5 and ASTM F1514-19(2025)

Conditioning: Condition the test specimens at $(23 \pm 2)^{\circ}\text{C}$ and $(50 \pm 5)\%$ relative humidity for at least 24h

Test Condition:

Temperature: 70 $^{\circ}\text{C}$

Exposure time: 7 days

Spectrophotometer: Under D65 standard light source, 10° observer

Test Result:

Specimen	ΔE^*	Average ΔE^*
1	0.23	0.27
2	0.28	
3	0.29	

Test Photo:



After exposure

Test Report

Original Issue Date: 2026-08-20

Intertek Report No. 260714002SHF-001

Test Items, Method and Results:

Test Item: Resistance to light

Test Method: ASTM F3261-25a section 8.6 and ASTM F1515-21

Conditioning: Condition the test specimens at $(23 \pm 2)^{\circ}\text{C}$ and $(50 \pm 5)\%$ relative humidity for at least 24h

Test Condition:

Light source:	Xenon-arc lamps
Irradiance:	0.30 W/(m ² ·nm) at 340nm
Black-panel temperature:	63 ± 2 °C
Relative humidity:	50 ± 10 %
Exposure time:	300 h
Spectrophotometer:	Under D65 standard light source, 10° observer

Test Result:

Specimen	ΔE^*	Average ΔE^*
1	0.53	0.48
2	0.45	
3	0.45	

Test Photo:



After exposure

Test Report

Original Issue Date: 2026-08-20

Intertek Report No. 260714002SHF-001

Test Items, Method and Results:

Test Item: Static load resistance

Test Method: ASTM F3261-25a section 8.7 and ASTM F970-22

Conditioning: Condition the test specimens at $(23 \pm 2)^{\circ}\text{C}$ and $(50 \pm 5)\%$ relative humidity for at least 24h

Test Condition:

Indenter diameter: 28.6 mm
Total load applied: 250 lb / 250 psi
Indentation time: 24 h
Recovery time: 24 h

Test Result:

Residual Indentation	Result (mm)
Specimen 1	0.10
Specimen 2	0.13
Specimen 3	0.11
Average value	0.11
Max. value	0.13

Test Report

Original Issue Date: 2026-08-20

Intertek Report No. 260714002SHF-001

Test Items, Method and Results:

Test Item: Coefficient of Friction (Dry condition)

Test Method: ASTM F3261-25a section 8.9 and ASTM D2047-25

Conditioning: Condition the test specimens at $(23 \pm 2)^{\circ}\text{C}$ and $(50 \pm 5)\%$ relative humidity for at least 24h

Test Result:

Static Coefficient of Friction (Standard Leather)	Dry: 0.52
--	-----------

Test Report

Original Issue Date: 2026-08-20

Intertek Report No. 260714002SHF-001

Appendix A: Sample Received Photo



Revision:

NO.	Date	Changes
260714002SHF-001	2026-08-20	First issue

WU FENGXIAN 07